


APPROVED FIBERGLASS (OR 1/4" A36 GALVANIZED STEEL PLATE) WITH CONTINUOUS WELDS, SECURED TO WALLS WITH 1/2" X 2" ANCHOR BOLTS. ALL BOLTS TO BE ZINC COATED IN ACCORDANCE WITH A.S.T.M. BS33 SCI TYPE 111.




TOP VIEW

BAFFLE


NOTES

1. ALL MATERIAL, DESIGN, MANUFACTURE, PHYSICAL TEST REQUIREMENTS, FINISH MARKING, INSPECTION, REJECTION, AND REPAIRS SHALL MEET TENTATIVE SPECIFICATIONS FOR PRECAST, REINFORCED CONCRETE MANHOLE RISERS AND TOPS PER A.S.T.M.-C478 LATEST REVISIONS.
2. PLASTIC STEPS SHALL BE PLACED IN LINE ON 16" CENTERS.
3. FOR USE IN COMBINED SEWER AREAS AS AN ODOR TRAP OR AS DIRECTED/REQUIRED.
4. MAY BE USED IN MANHOLES AND CATCH BASINS.



TYPICAL CURB INLET TOP

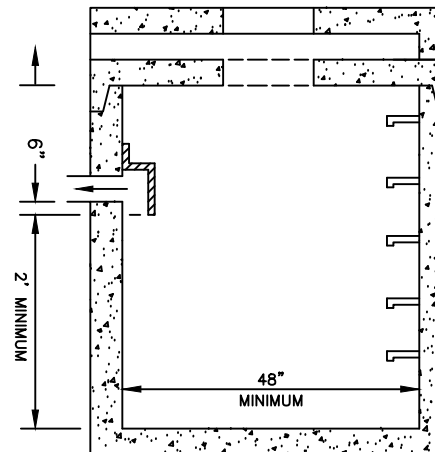

SECTION - CURB INLET

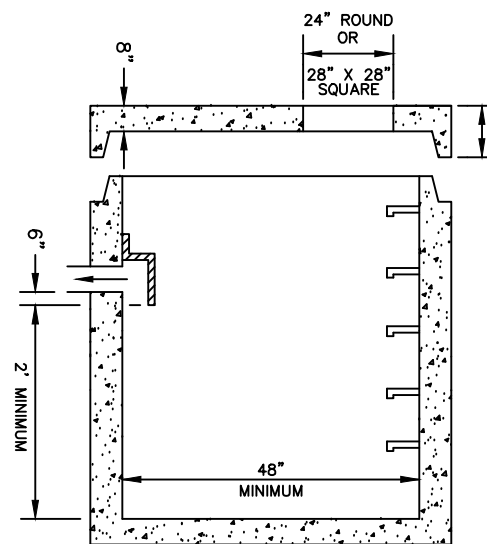

SECTION - FLAT TOP



0	INITIAL ISSUE	8/24/01
NO.	REVISION	DATE

CITY OF CHATTANOOGA AND HAMILTON COUNTY
ODOR CONTROL STRUCTURE

DATE OF ORIGINAL ISSUE
AUGUST 24, 2001

STANDARD NUMBER: **SD-310.01**